



University of
Massachusetts
Amherst

2014 Update Mtg: Recommendations for Reducing Phosphorus Loss in Cranberry Floodwaters

Item Type	article;article
Authors	Kennedy, Casey
Download date	2026-04-12 11:52:32
Link to Item	https://hdl.handle.net/20.500.14394/8805

Casey Kennedy
USDA-ARS

**Recommendations For Reducing
Phosphorus Loss in Cranberry
Floodwaters**


Who Cares?

- The State (Mass DEP)
 - Total Maximum Daily Load (TMDL) established on White Island Pond
 - TMDL for Monponsett Pond in development
- The Industry
 - Perception matters
 - Cascading effect – you may not be the problem, but may suffer the consequences
- The Research Community
 - Multiple groups, academic and advocacy, are pursuing this research


What Do We Know?

- Not a whole lot, but some
- Two studies on cranberry P loss
 - Howes and Teal (1995)
 - “Most rigorous” of nutrient loss studies
 - Concentration-discharge approach
 - Daily measurements, assumed negligible groundwater loss
 - Cranberry bog P loss of $9.9 \text{ kg ha}^{-1} \text{ yr}^{-1}$
 - DeMoranville and Howes
 - Assumed steady state to calculate discharge, measured P in grab samples
 - Cranberry bog P loss of $3.5 \text{ kg ha}^{-1} \text{ yr}^{-1}$ for organic non-flow through bog


Howes and Teal

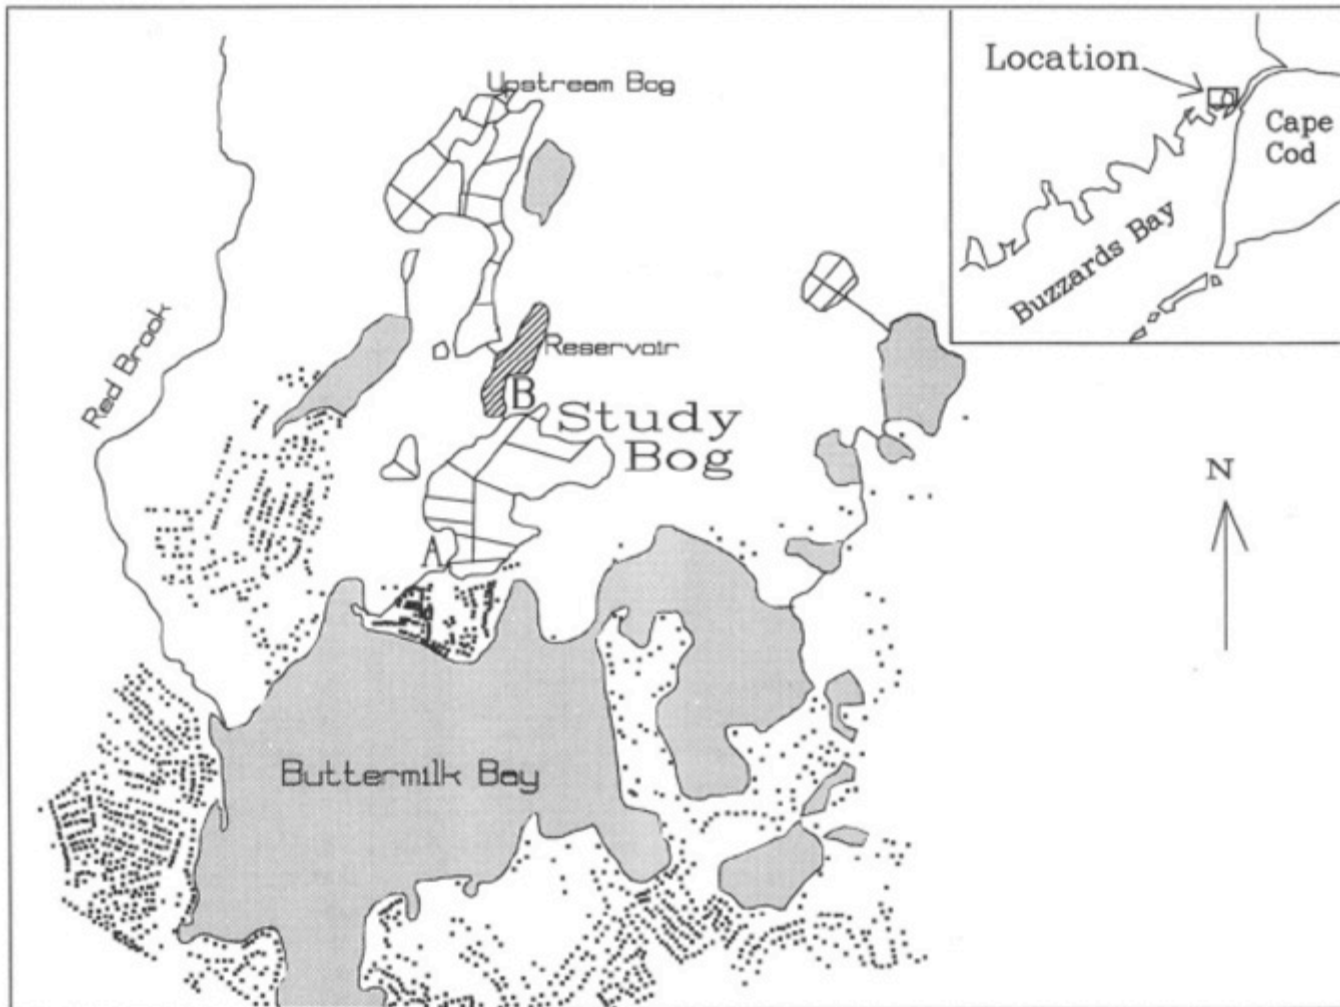

Howes and Teal

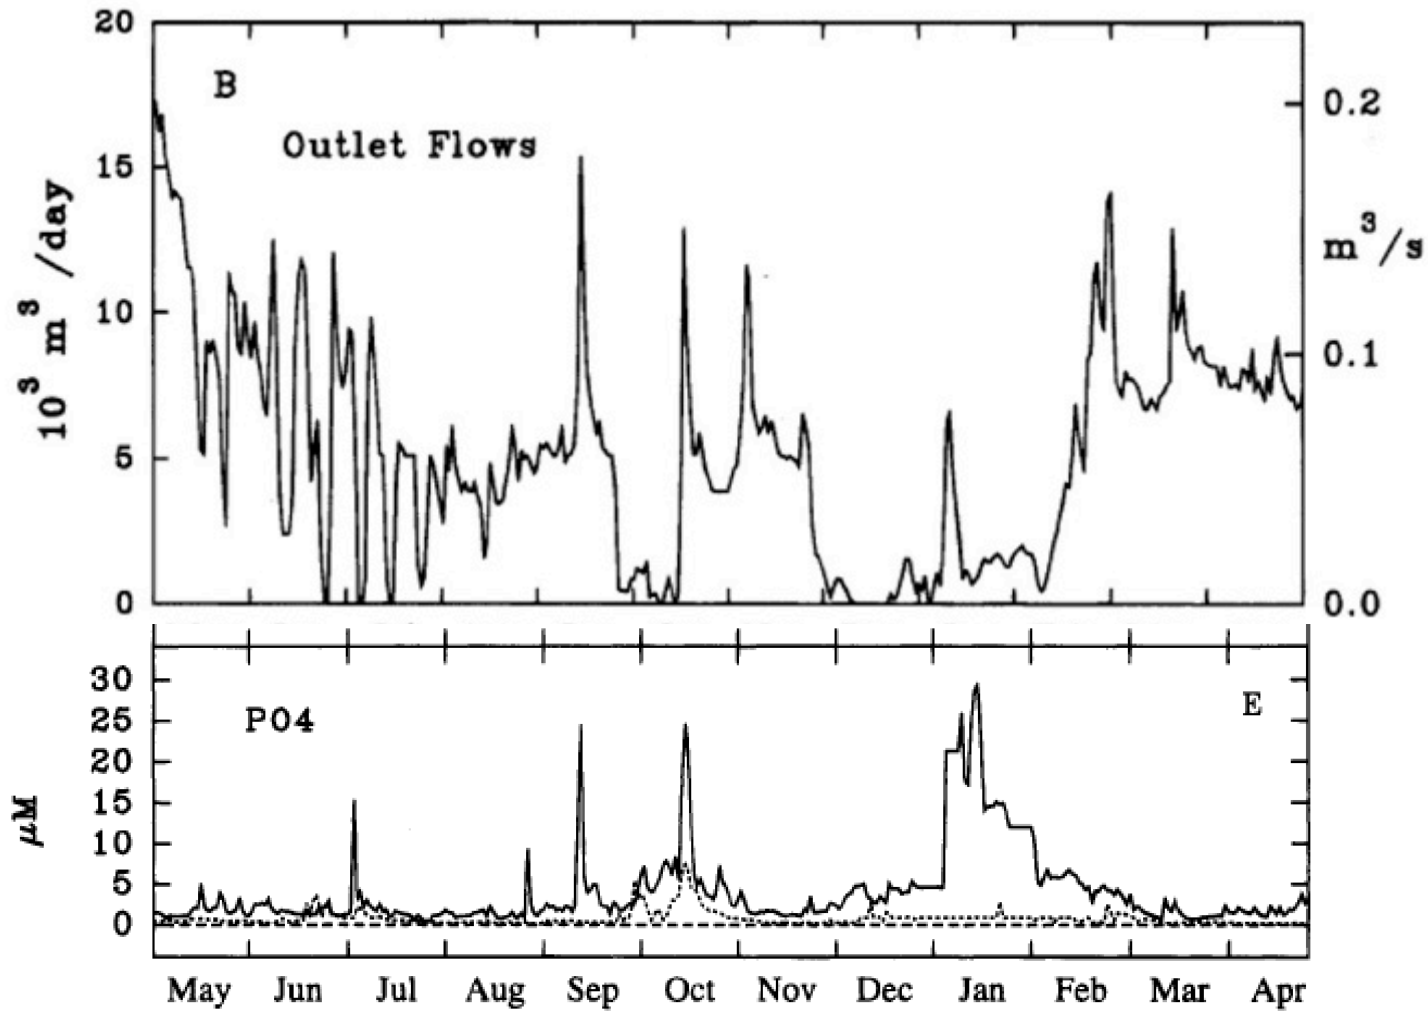

Howes and Teal

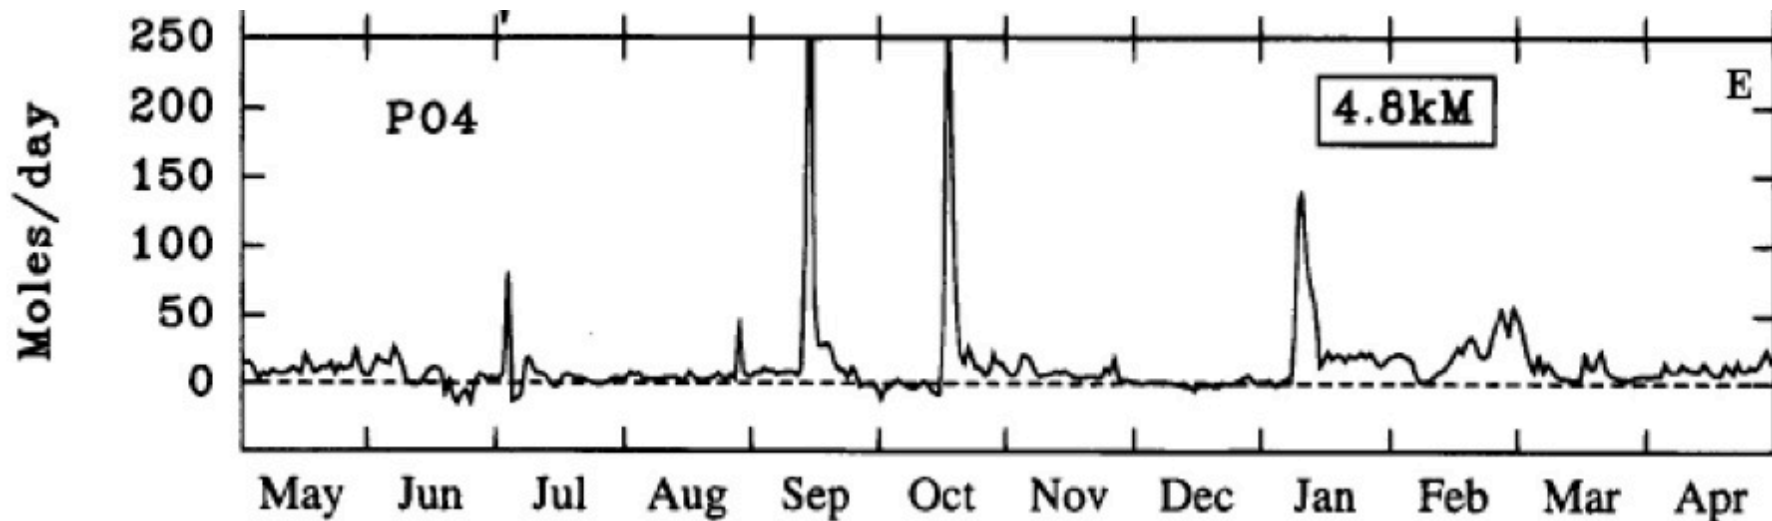


Cranberry Bog P loss = 9.9 kg P ha⁻¹ yr⁻¹

White Island Pond

Final Total Maximum Daily Load of Total Phosphorus for
White Island Pond, Plymouth/Wareham, MA



Assuming these same bogs are acting as flow-through bogs, the high land use export coefficient of 9.9 kg/ha/yr from Howes and Teal (1995) is applied to the bog areas listed above. This results

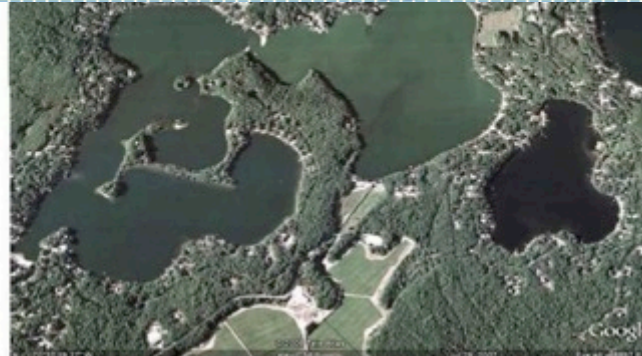

COMMONWEALTH OF MASSACHUSETTS
EXECUTIVE OFFICE OF ENERGY AND ENVIRONMENTAL AFFAIRS
IAN A BOWLES, SECRETARY
MASSACHUSETTS DEPARTMENT OF ENVIRONMENTAL PROTECTION
LAURIE BURT, COMMISSIONER
BUREAU OF RESOURCE PROTECTION
GLENN HAAS, ACTING ASSISTANT COMMISSIONER



Monponsett Pond


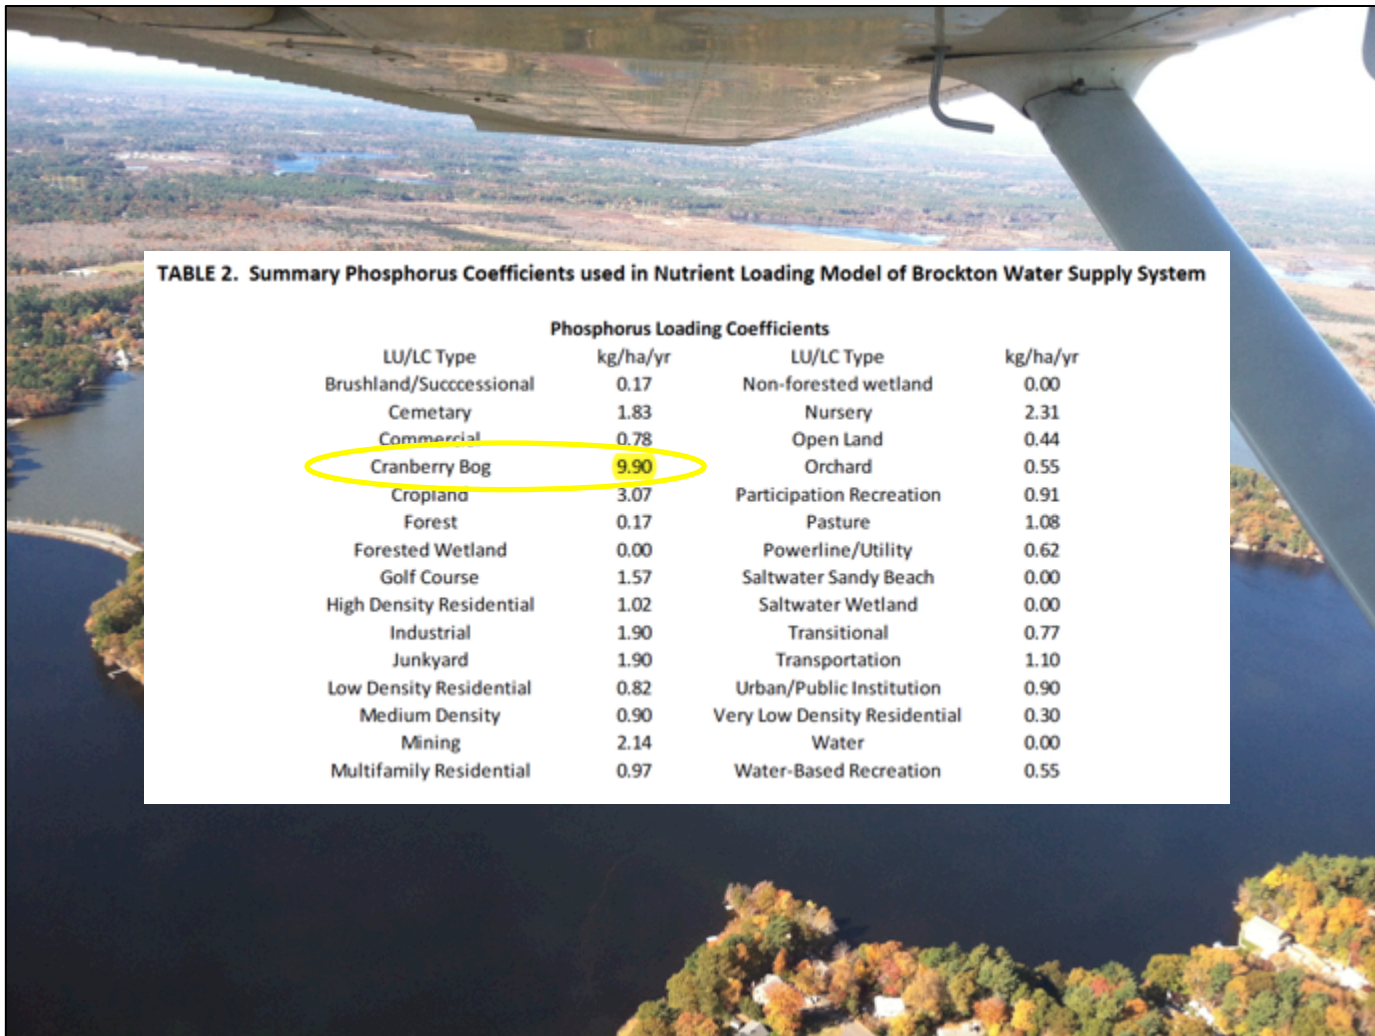



TABLE 2. Summary Phosphorus Coefficients used in Nutrient Loading Model of Brockton Water Supply System

Phosphorus Loading Coefficients			
LU/LC Type	kg/ha/yr	LU/LC Type	kg/ha/yr
Brushland/Successional	0.17	Non-forested wetland	0.00
Cemetery	1.83	Nursery	2.31
Commercial	0.78	Open Land	0.44
Cranberry Bog	9.90	Orchard	0.55
Cropland	3.07	Participation Recreation	0.91
Forest	0.17	Pasture	1.08
Forested Wetland	0.00	Powerline/Utility	0.62
Golf Course	1.57	Saltwater Sandy Beach	0.00
High Density Residential	1.02	Saltwater Wetland	0.00
Industrial	1.90	Transitional	0.77
Junkyard	1.90	Transportation	1.10
Low Density Residential	0.82	Urban/Public Institution	0.90
Medium Density	0.90	Very Low Density Residential	0.30
Mining	2.14	Water	0.00
Multifamily Residential	0.97	Water-Based Recreation	0.55


Managing P in Floodwaters

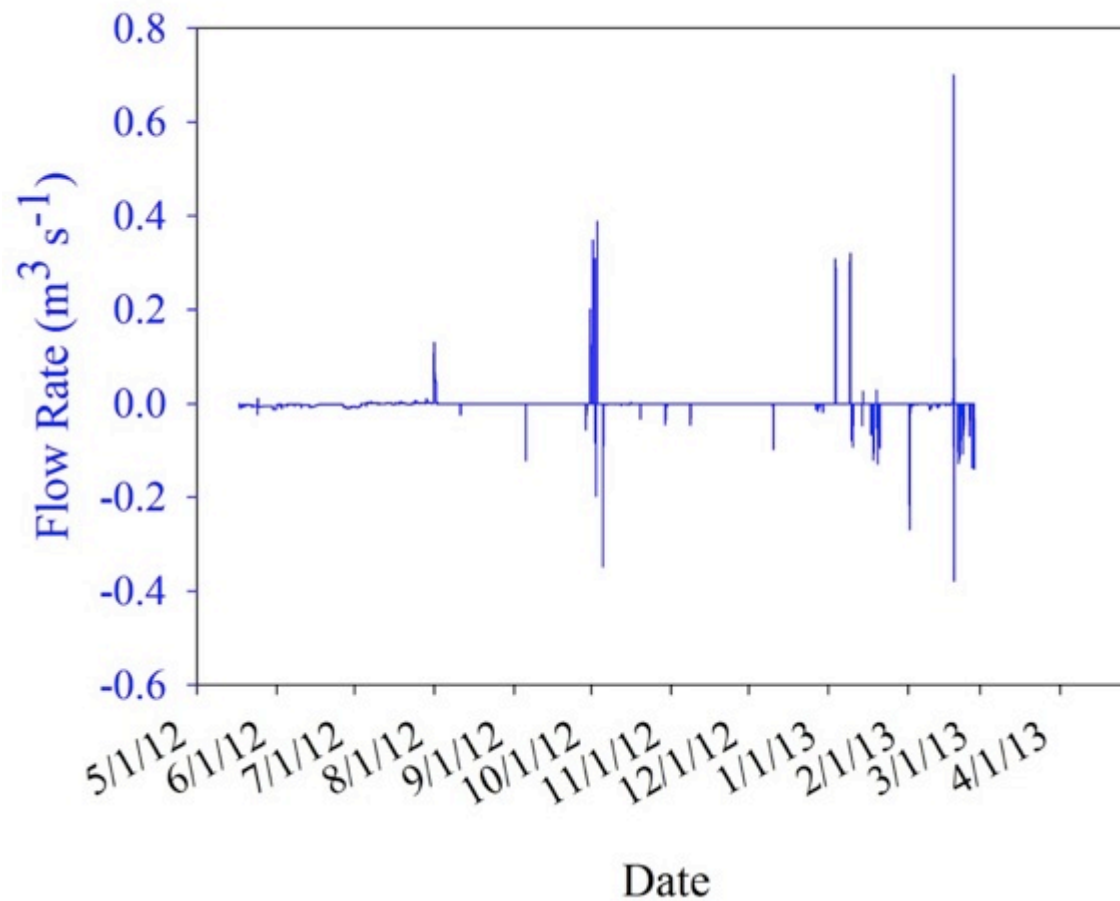


Enhance Particulate Settling

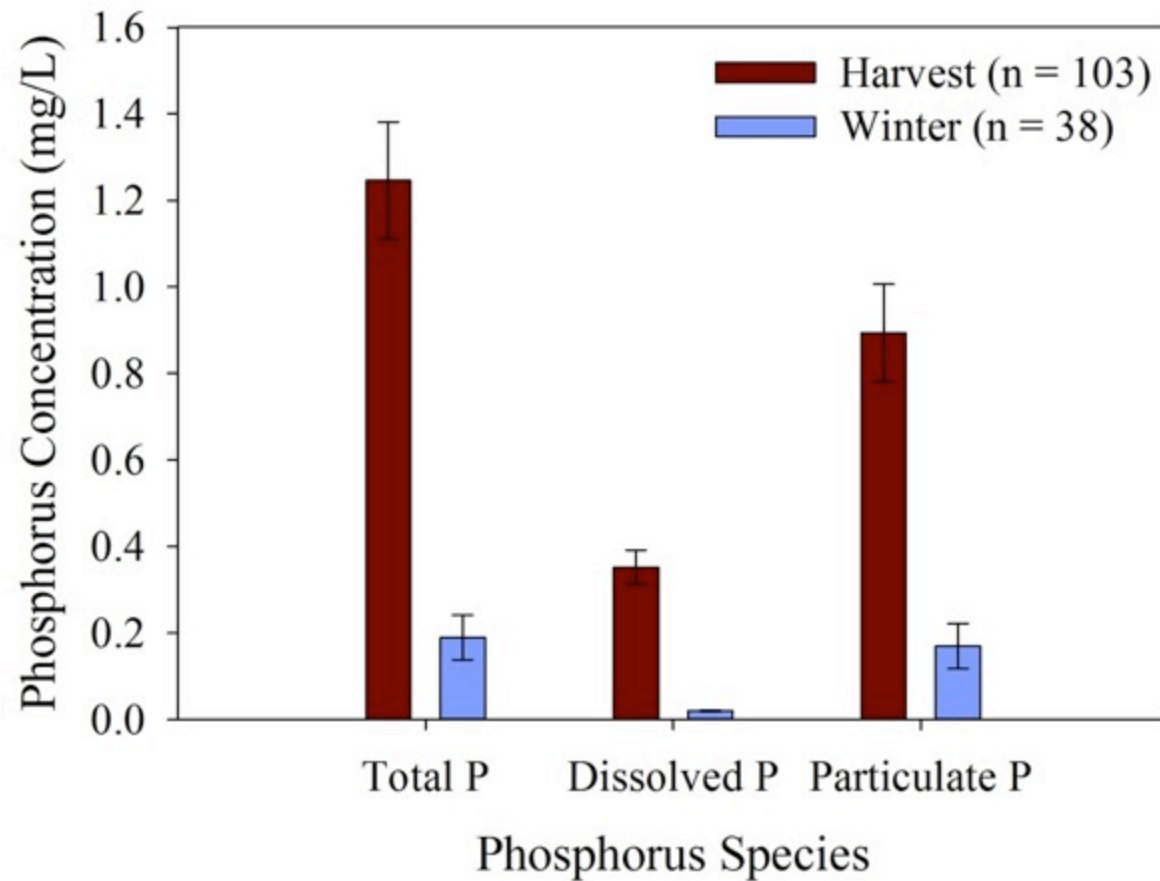


Peak TP in Harvest Release Water

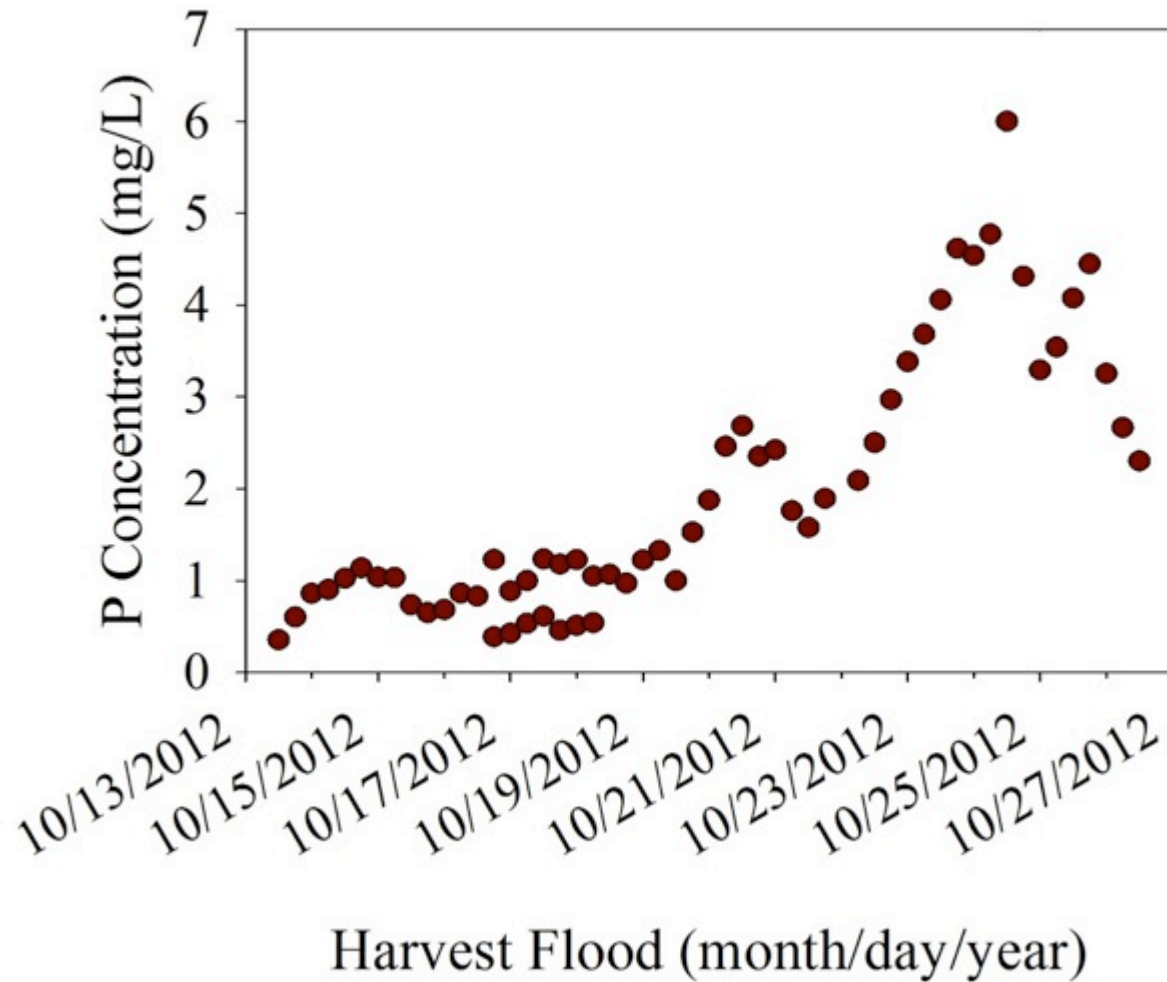

Depth Effect

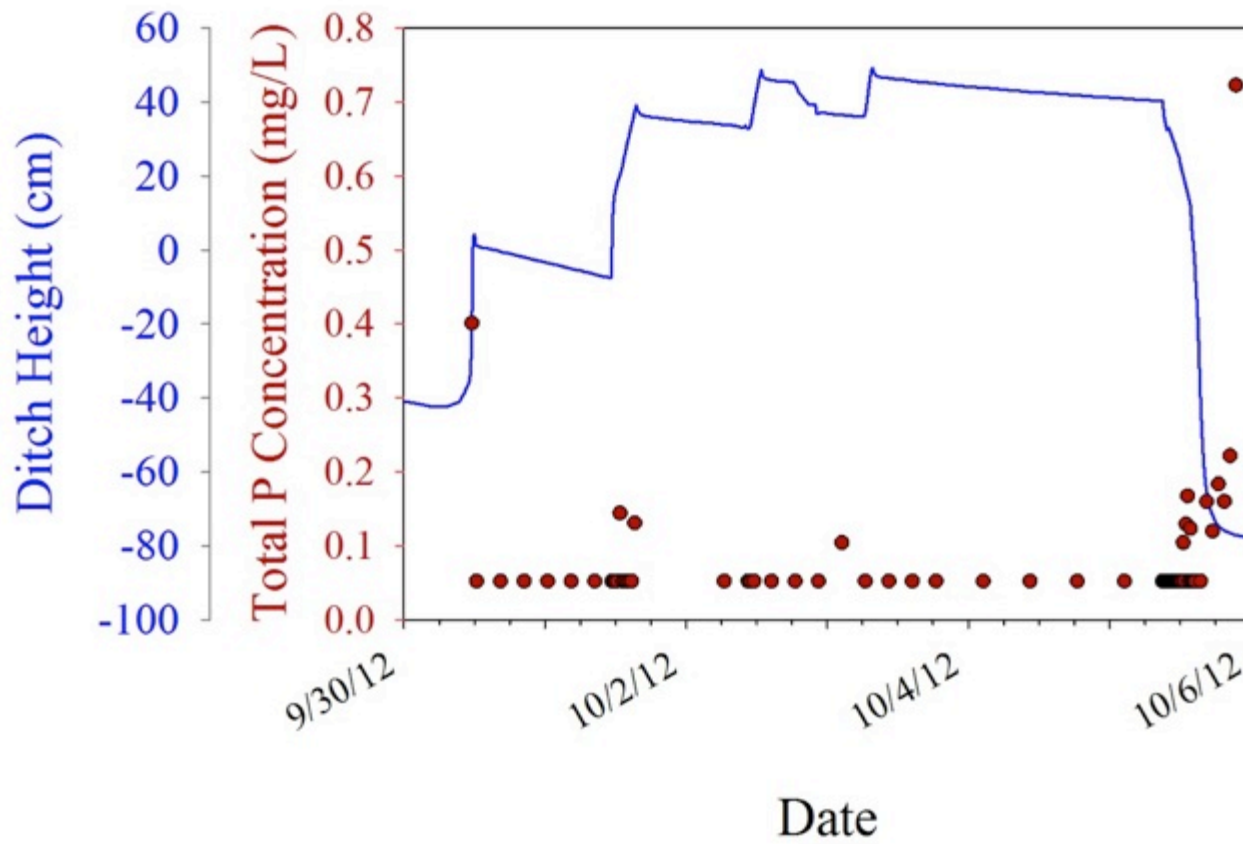

Depth AND Velocity Effect

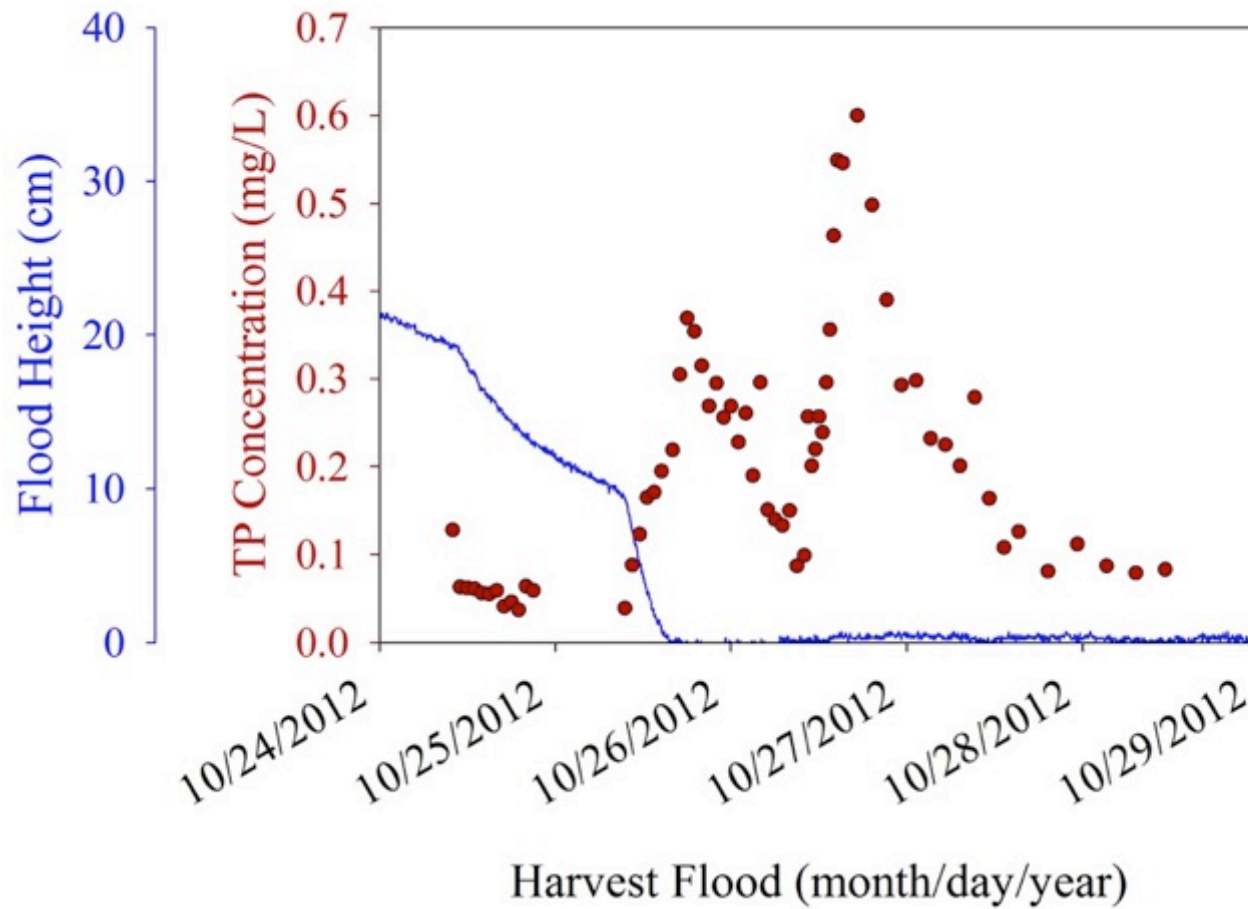

Recommendation 1: Emphasis on Harvest Flood

- All floods are NOT created equal
- Mean harvest TP concentration is 7 times higher than that in the winter flood
- P mass loss needs to be more fully explored for winter flood, but initial results suggest greater P loss during the harvest flood

Recommendation 2: Increase Settling of Particulate P

- Most of the P loss is in the particulate fraction, between 70-90% of total P
- Increased holding times is NOT enough, need to slow the releases, too
- Secondary holding structure may facilitate slow release of P laden water

Recommendation 3: Target High P Floodwaters

- Moments of high P occur during the later part of the release
- If feasible, use lower pump rate to discharge these floodwaters
- Alternatively, route these high P water to secondary holding ponds
- Amendments may be available to immobilize P in floodwaters

Recommendation 4: Identify High P Sites

- Working on developing environmental threshold test for identifying high P sites
- These sites should receive highest priority in terms of reducing P loss

Recommendation 5: Grower Cooperation

- I am here to help... No, REALLY!
- Excellent relationships with many growers
 - Gary Weston and Curt Young (Federal Furnace)
 - George Rogers, Niki D'Azortino, and others (ADM)
 - Matt Rhodes and Dan Bruffee (Edgewood Farms)
 - Jim Moores and Davie Townes/Boom Boom (Cranberry Station)
- More will be needed for future success

Acknowledgements

- Technical assistance from Cassie Rogers (UMass/ARS) and Peter Kleinman (ARS, University Park, PA)
- Support from Carolyn DeMoranville and the Cranberry Station
- Several grower participants

Questions (for me, not Frank)

